



ENERGY ABSORPTION CAPACITY PLATE TEST

Tested in accordance with section G10.4 EFNARC 1999

Client	Fibsol				
Project	R & D	Mix 1			
Date Tested	07 October 2013	Fibre Type	Macrosol CX 50/40	Ref No	Panel 6
Job No	13200	Lab No	1541C	Checked	EM
Calibration Date	29 February 2012	Calibration Certificate	2931		

1. Panel Thickness - 2 readings taken on each cut face of the panel


Side A (mm)		Side B (mm)		Side C (mm)		Side D (mm)		Min	Max	Average
100	100	100	100	100	100	100	100	100	100	

2. Age Data

Date Cast	09-09-13	Date Tested	07-10-13	Age when tested	28	Days
-----------	----------	-------------	----------	-----------------	----	------

3. Results

Energy Absorption	420 Joules	Approximate Relative Density	kg/m3
ITASCA Corrected Energy Absorption Value	463 Joules		

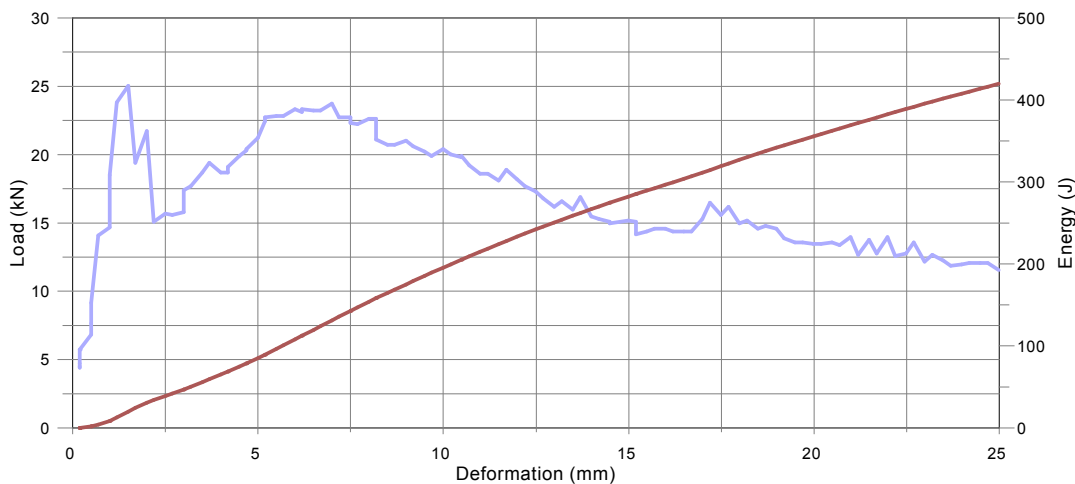

Fibre Dosage : 60g / 30kg Bag